


PLAN
NTS

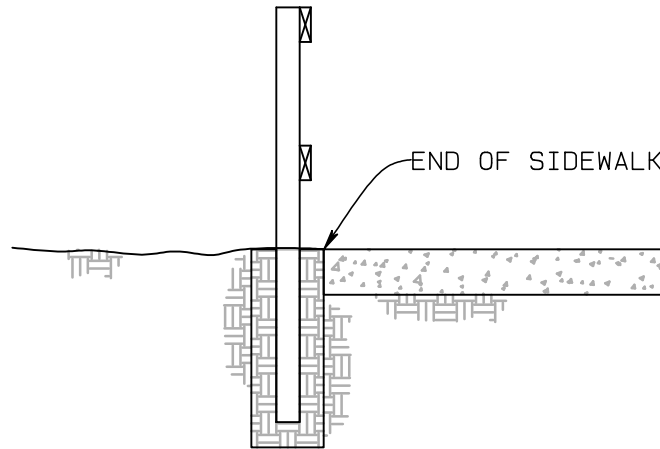

SECTION A-A
NTS

NOTES:

1. 4"x 4" POST SHALL BE PRESSURE TREATED CONFORMING TO SECTION 56-2 OF CALTRANS SPECIFICATIONS, EXCEPT THAT REDWOOD SHALL NOT BE ALLOWED.
2. POSTS SHALL BE BACKFILLED WITH COMPACTED EARTH.
3. 2" x 6" CROSS BOARDS SHALL BE S4S DOUGLAS FIR FASTENED TO POSTS WITH 1/2" GALVANIZED BOLTS, WASHER AND NUTS COUNTERSUNK AT BOTH ENDS.
4. BARRICADE SHALL BE PAINTED WHITE (1 COAT PRIMER AND 2 COATS ENAMEL) AFTER ERECTION.

**COUNTY OF SONOMA
DEPARTMENT OF TRANSPORTATION
AND PUBLIC WORKS**

SIDEWALK BARRICADE

DATE: NOV 2009	SCALE: NONE	DRAWING NO.
REVISED:		229