


RISER QUADRANT SPECIFIED  
BE PG&E OR PER SERVING  
UTILITY REQUIREMENTS

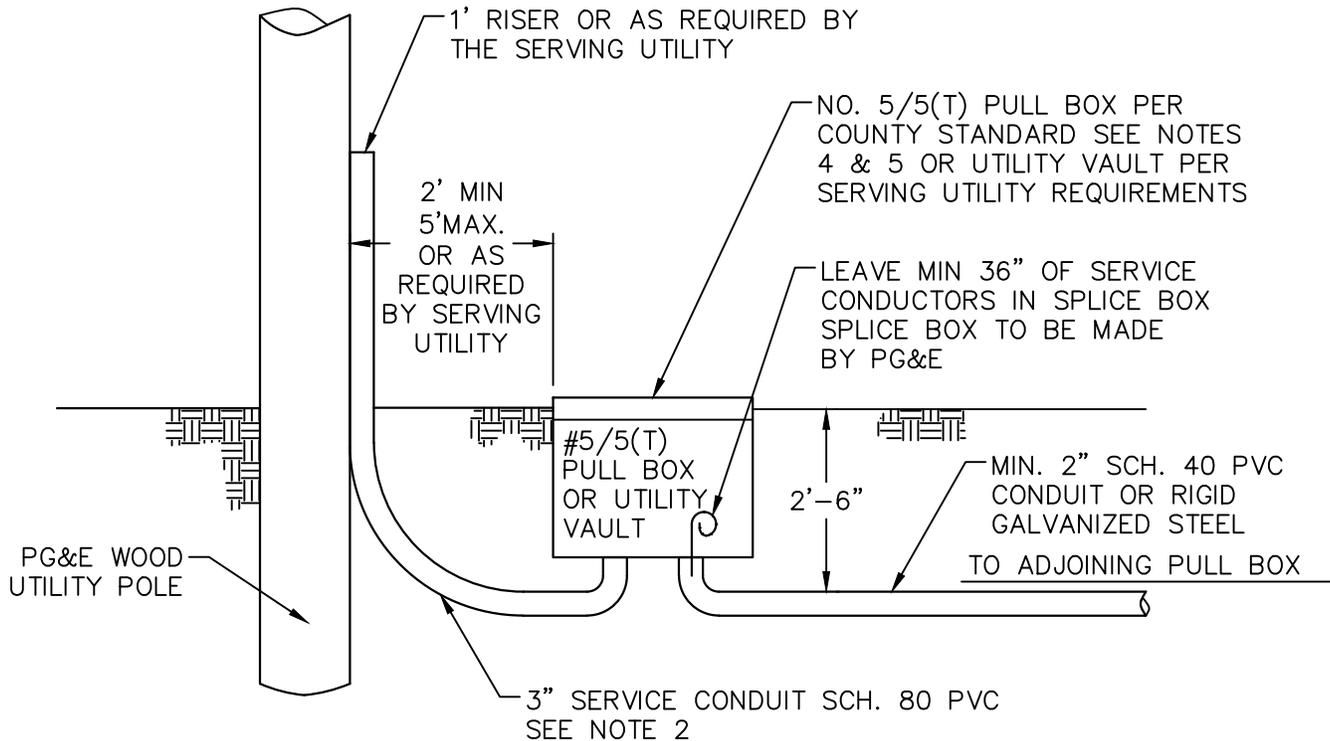

## OVERHEAD SERVICE

### NOTES:

1. CONSTRUCTION SHALL CONFORM TO THESE REQUIREMENTS EXCEPT AS OTHERWISE DIRECTED BY THE COUNTY ENGINEER.
2. CONTRACTOR SHALL INSTALL #5/5(T) PULL BOX OR UTILITY VAULT PER SERVING UTILITY REQUIREMENTS, 3" SERVICE CONDUIT, AND 2" CONDUIT AND CONDUCTORS FROM EQUIPMENT TO PULL BOX.
3. CONDUIT AND CONDUCTOR TO ENTER PULL BOX THROUGH BOTTOM OF BOX. PULL BOXES SHALL BE PARALLEL WITH THE ROADWAY.
4. SEE COUNTY DRAWING NO. 600, NOTE NO. 3 TO DETERMINE IF A #5 OR 5(T) PULL BOX IS REQUIRED. ALSO CHECK PLANS AND NOTES.

COUNTY OF SONOMA  
DEPARTMENT OF TRANSPORTATION  
AND PUBLIC WORKS

ELECTRIC SERVICE DETAIL  
OVERHEAD SERVICE

DATE: MAY 2004

REVISED: APRIL 2019

APPROVED BY:

SCALE:  
NONE

DRAWING NO.  
608